

# **Modeina Estate - Stage 22, Burnside (Level 1)**

## **Level 1 Inspection & Testing Report**

Reference: 1120 0252-1



### **Prepared for:**

DFC (Project Management) Pty Ltd

November 2021



**A&Y ASSOCIATES**  
GEOTECHNICAL ENGINEERING CONSULTANTS

# Document Control Record

Prepared by:

**A&Y Associates Pty Ltd**

ABN 92 614 244 665

5/16 Network Drive

Truganina, VIC 3029

**T:** (03) 8754 8325

**E:** info@ayassociates.com.au

**W:** www.ayassociates.com.au

## Document control

<b>Report title</b>		Level 1 Inspection & Testing			
<b>Project reference number</b>		1120 0252-1			
<b>Client</b>		Excell Gray Bruni On behalf of DFC (Project Management) Pty Ltd			
<b>Contact name</b>		Tom Vas			
<b>Contact number</b>		0457 873 274			
<b>Contact e-mail</b>		thomas.vas@graybruni.com.au			
<b>Revision</b>	<b>Date</b>	<b>Descriptions/Status</b>	<b>Author</b>	<b>Reviewer</b>	<b>Approver</b>
0	18/11/2021	Final	B Mu	A Tan	A Tan

## Approver



Alvin Tan

(BE Civil and Infrastructure), MIEAust

Senior Geotechnical Engineer

E: alvin@ayassociates.com.au | M: 0449 288 338



ENGINEERS  
AUSTRALIA  
Professional Engineer  
MEMBER

---

## **Disclaimer**

The findings and conclusions contained in this report are made based on site conditions that existed at the time this work was conducted. The conclusions present in this report are relevant to the conditions of the site and the state of legislation currently enacted as at the date of this report.

Findings and conclusions are made assuming that the soil, groundwater, geological and chemical conditions detailed within this report are accurate and remain applicable to the site at the time of writing. No other warranties are made or intended.

A&Y Associates (A&Y) Pty Ltd has used a degree of skill and care ordinarily exercised by reputable members of our profession practicing in the same or similar locality.

A&Y does not make any representation or warranty that the conclusions in this report will be applicable in the future as there may be changes in the condition of the site, applicable legislation or other factors that would affect the conclusions contained in this report.

This report has been prepared exclusively for use by our client. This report cannot be reproduced without the written authorisation of A&Y and then can only be reproduced in its entirety.

## **Applicability**

This report has been prepared for the benefit for our client with respect to the particular brief given to us and it may not be relied upon in other contexts or for any other purpose without our prior review and agreement.

No responsibility for this report will be taken by A&Y if it is altered in any way, or not reproduced in full.

---

## Contents

<b>1</b>	<b>Introduction.....</b>	<b>3</b>
<b>2</b>	<b>Project Summary .....</b>	<b>3</b>
<b>3</b>	<b>Project Specifications .....</b>	<b>4</b>
<b>4</b>	<b>Subgrade Assessment .....</b>	<b>5</b>
<b>5</b>	<b>Earthworks .....</b>	<b>5</b>
<b>6</b>	<b>Fill Material .....</b>	<b>5</b>
<b>7</b>	<b>Testing.....</b>	<b>6</b>
<b>8</b>	<b>Exclusion .....</b>	<b>6</b>
<b>9</b>	<b>Conclusion .....</b>	<b>7</b>
	<b>Appendix A - Site Plan .....</b>	<b>8</b>
	<b>Appendix B – Test Locations .....</b>	<b>10</b>
	<b>Appendix C – Test Results Summary.....</b>	<b>12</b>
	<b>Appendix D – NATA Test Results .....</b>	<b>14</b>

---

## 1 Introduction

This report presents the results of the Level 1 Inspection and Testing for the construction of the fill platforms located in Modeina Estate - Stage 22 - Burnside.

## 2 Project Summary

It is understood that Excell Gray Bruni, on behalf of DFC (Project Management) Pty Ltd require the fill platforms within Modeina Estate - Stage 22 - Burnside to be constructed under Level 1 Inspection and Testing undertaken by a Geotechnical Inspection and Testing Authority (GITA).

Level 1 Inspection and Testing, as defined in AS3798-2007 "Guidelines on Earthworks for Commercial and Residential Development," provides for full time inspection of the construction of controlled fill and field and laboratory testing in accordance with AS1289 "Methods of Testing Soils for Engineering Purposes".

The Level 1 inspection was undertaken by a Geotechnician from A&Y Associates over a period of three working days from **22<sup>nd</sup> June 2021 to 24<sup>th</sup> June 2021**.

This report is applicable for fill placed by DFC (Project Management) Pty Ltd for the shaded areas at the following lots located in Modeina Estate - Stage 22 - Burnside, as shown in Appendix A – Site Plan.

- Lot 2220 - 2234

---

### 3 Project Specifications

No specification has been provided for the construction works in Modeina Estate - Stage 22, Burnside. The supervision and inspections were performed based on AS3798.

A short summary of the requirements outline in AS3798 is provided below:

- All filling in excess of 300mm depth within the building envelope of allotments shall be undertaken to specifications satisfying the requirements of AS3798.
- Material to be used for fill construction shall satisfy the requirements of AS3798-2007 "Guidelines on Earthworks for Commercial and Residential Developments". Material used shall be free of:
  - Organic soils, such as topsoils, severely root affected subsoil and peat;
  - Contaminated soils;
  - Materials which undergo volume change or loss of strength when disturbed and exposed to moisture;
  - Silts, or materials that have deleterious engineering properties of silt;
  - Fill that contains wood, metal, plastic, boulders, or other deleterious material, in sufficient proportions to affect the required performance of fill;
  - The maximum particle size of any rocks or other lump, within the layer, has not exceeded two-thirds (2/3) of the compacted layer thickness.
- Compaction to achieve a dry density ratio of at least 95% Standard, as the project was classified as **Residential**.

---

## 4 Subgrade Assessment

The subgrade was assessed by A&Y Associates following the topsoil removal and before any fill was placed. The subgrade assessment was undertaken on the **22<sup>nd</sup> June 2021** as mentioned in report *1120 0252-1 (SSI1)*.

The exposed subgrade material comprised natural silty clay. No wet or soft patches were found during the inspection. No evidence of deleterious material was found during the inspection.

## 5 Earthworks

The earthworks for this project included stripping of topsoil, removing of tree roots, proof rolling the subgrade and placement and compaction of fill to construct engineered platforms.

The earthworks for this project included stripping of topsoil, removing of tree roots, proof rolling the subgrade and placement and compaction of fill to construct engineered platforms.

Based on design plans and site inspection, it appears that the approximate fill thickness placed ranges from 150mm to 300mm. The fill layers or thickness nominated in this report are provided as a guide on the amounts of fill placed and do not necessarily reflect an accurate survey of the fill levels.

## 6 Fill Material

The fill material used for the platform consisted of site derived material. The material was predominantly comprised of Silty Clay.

---

## 7 Testing

Field density testing was undertaken on the compacted fill at a frequency of a minimum of 3 tests per lot (AS3798 Table 8.1).

Tests were performed using a Nuclear Density Gauge for field density determination as per AS 1289.5.8.1. Testing was completed at a minimum rate of 3 field density tests per day's production based on the minimum requirements of AS 3798-2007 and taken from each layer of fill placed.

A total of 9 field density tests were performed during the earthworks. All of the test results met the specified compaction requirement of 95% Standard Compaction.

The locations of the 9 field density tests are shown in Appendix B – Test Locations. A summary of the test results obtained from the field density testing is presented in Appendix C – Test Results Summary. The laboratory test reports of the field density tests are presented in Appendix D – NATA Test Results.

## 8 Finish Surface Levels

It should be noted that even though the final fill layer meets the specification requirements, over time, the material may be subject to adverse weather conditions resulting in either surface softening or drying and cracking. The top 200mm – 300mm of the fill will deteriorate with time and should be considered by the foundation engineer.

## 9 Exclusion

A&Y Associates was not involved in monitoring and testing the following works and as such are not included in the Level 1 report.

- Any trenches excavated and backfilled on site for the installation of underground services such as sewers, electrical conduits, water mains etc.
- Footpaths in front of the lots that may be excavated and filled after the Level 1 supervision conducted by A&Y Associates.
- Uncontrolled fill and topsoil that may have been placed as part of the landscaping of the site following the completion of the engineered fill construction.



---

## 10 Conclusion

On the completion of the earthworks and after analysing the materials used, it has been concluded that the filling procedure conducted by Excell Gray Bruni appears to be consistent with the requirements of AS 3798 in regards to the placement of fill materials on a project under Level 1 Supervision and in accordance with the project specification as provided to A&Y Associates.


This report has been prepared for the benefit of DFC (Project Management) Pty Ltd c/o Excell Gray Bruni with respect to the particular brief given to us and it may not be relied upon in other contexts or for any other purpose without our prior review and agreement. No responsibility for this report will be taken by A & Y Associates if it is altered in any way, or not reproduced in full.

---

## **Appendix A - Site Plan**



THESE DRAWINGS ARE TO BE USED ONLY FOR THE PURPOSE FOR WHICH THEY WERE INTENDED.  
NO RESPONSIBILITY WILL BE BORNE BY THE ENGINEERING CONSULTANT SHOULD THESE DRAWINGS  
BE USED FOR ANY OTHER PURPOSE.



TYPICAL VEHICLE  
CROSSING DETAIL

NOT TO SCALE

FOR CONSTRUCTION

[illegible]

22 Business Park Drive Notting Hill 316  
A.C.N. 006 560 803  
E: [consulting@dpnrvic.com.au](mailto:consulting@dpnrvic.com.au)  
W: [www.dpnrvic.com.au](http://www.dpnrvic.com.au)  
T: (03) 9638 5000



DE WITTE	J. BEVERIDGE
DE WITTE	J. BEVERIDGE
DE WITTE	L. PAPAZOIS
DE WITTE	T. DAVOLI

AUTHORITY:	CITY OF MELTON
SUBJECT:	MODEINA STAGE 22
DETAILS:	LAYOUT PLAN &

SERVICES OFFSET TABLE

SCALE	1:500
LEVEL DATUM	AHD
SHEET	2 OF 11
DRAWING No.	1275/22/NE/2

**CLIENT:**  
**Excell Gray Bruni**

PROJECT No:	1120 0252-1
-------------	-------------

**SITE PLAN SKETCH—NOT TO SCALE**




---

## **Appendix B – Test Locations**



THESE DRAWINGS ARE TO BE USED ONLY FOR THE PURPOSE FOR WHICH THEY WERE INTENDED.  
NO RESPONSIBILITY WILL BE BORNE BY THE ENGINEERING CONSULTANT SHOULD THESE DRAWINGS  
BE USED FOR ANY OTHER PURPOSE.

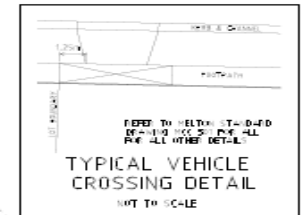

## LAYOUT PLAN

© 1995 by J. B. Macdonald

FOR CONSTRUCTION

[illegible]

22 Business Park Drive Notting Hill 316  
A.C.N. 006 550 803  
E: [consulting@dpnvc.com.au](mailto:consulting@dpnvc.com.au)  
W: [www.dpnvc.com.au](http://www.dpnvc.com.au)  
T: (03) 9538 5000



DE-40114	J. BEVERIDGE
DE-40121	J. BEVERIDGE
DE-40124	L. PAPAZIO
DE-40125	T. DAVOLI

ADDRESS:	CITY OF MELTON
PROJECT:	MODEINA STAGE 22
DETAILS:	LAYOUT PLAN &

### SERVICES OFFSET TABLE

SCALE	1:500
LEVEL DATUM	AHD
SHEET	2 OF 11
DRAWING No.	1275/22/NE/2

<b>CLIENT:</b> <b>Excell Gray Bruni</b>
--

PROJECT No:	1120 0252-1
-------------	-------------

**SITE PLAN SKETCH—NOT TO SCALE**



**A&Y ASSOCIATES**  
GEOTECHNICAL ENGINEERING CONSULTANTS

---

## **Appendix C – Test Results Summary**



Project No		1120 0252-1			Client	Excell Gray Bruni				
Project Name		Modeina Estate - Stage 22			Specification			Density Ratio ≥ 95% of Peak Wet Density		
Location		Burnside								
Test No	Retest of Test	Date	Location	Layer	Oversize	Density Ratio	Moisture Ratio	Moisture Variation	Pass / Fail	Retest
#	#		Lot #	#	%	%	%	%		Pass / Fail
1	-	22/06/2021	-	1	3.5	95.5	90.0	-3.0	Pass	-
2	-	22/06/2021	-	1	0.0	95.0	91.0	-2.5	Pass	-
3	-	22/06/2021	-	FSL	0.0	95.5	89.5	-3.0	Pass	-
4	-	23/06/2021	-	2	0.0	96.5	96.0	-1.0	Pass	-
5	-	23/06/2021	-	2	0.0	99.5	97.5	-0.5	Pass	-
6	-	23/06/2021	-	1	0.0	97.0	99.5	0.0	Pass	-
7	-	24/06/2021	-	1	3.3	96.5	89.5	-2.5	Pass	-
8	-	24/06/2021	-	1	2.4	95.5	90.5	-2.5	Pass	-
9	-	24/06/2021	-	FSL	2.7	95.5	90.0	-2.5	Pass	-
</										

---

## **Appendix D – NATA Test Results**



## Field Density Test Results AS1289.5.7.1

<b>Client:</b>	Excell Gray Bruni			<b>Job No:</b>	EGB1704		
<b>Project:</b>	Modeina Estate - Stage 22 (Level 1)			<b>Report:</b>	1		
<b>Location:</b>	Burnside						

Sample No	1	2	3			
Date Tested	22/06/2021	22/06/2021	22/06/2021			
Time Tested	AM	AM	PM			

Test Location	Refer to Plan	Refer to Plan	Refer to Plan			
Level/Layer	1	1	FSL			
Layer Thickness	mm 150	150	150			
Test Depth	mm 125	125	125			
Field Wet Density	t/m <sup>3</sup> 1.85	1.83	1.81			
Field Moisture Content	% 26.6	25.9	25.1			
Material:	Site Derived Clay	Site Derived Clay	Site Derived Clay			

Oversize Material	WET, %	3.5	0.0	0.0		
Sieve Size	mm	19	19	19		
Peak Converted Wet Density	t/m <sup>3</sup>	1.93	1.92	1.89		
Optimum Moisture Content	%	29.5	28.5	28		



  

<b>Moisture Ratio</b>	%	90	91	89.5		
<b>Moisture Variation</b>	%	-3.0	-2.5	-3.0		
<b>from OMC</b>		Drier	Drier	Drier		
<b>Density Ratio</b>	%	95.5	95.0	95.5		


  

<b>Specification:</b>	95% STD	<b>Test Selection:</b>	N/A
<b>Notes:</b>	Ref: 1120 0252-1 (SI01)		
<b>Test Method</b>	AS1289 5.8.1, 5.7.1, 2.1.1, 1.1	<b>Sampling Method:</b>	AS 1289 1.2.1 6.4(b)

 <p><b>NATA</b> WORLD RECOGNISED ACCREDITATION</p>	<p>NATA Accredited Laboratory No. 20172</p> <p>Accreditation for compliance with ISO/IEC 17025 - Testing</p> <p>The results of tests, calibrations and/or measurements included in this document, are traceable to Australian / National Standards</p>	<p>Approved Signatory:</p>  <p>David Burns</p> <p>Date: 23/06/2021</p>
---	--	---



PROJECT: Modeina Estate – Stage 22 (Level 1)	CLIENT: Excell Gray Bruni	DATE: 22/06/2021	 <b>A&amp;Y ASSOCIATES</b> GEOTECHNICAL ENGINEERING CONSULTANTS
LOCATION: Burnside	PROJECT No: 1120 0252-1 (SI01)	SITE PLAN SKETCH—NOT TO SCALE	

## Field Density Test Results AS1289.5.7.1

<b>Client:</b>	Excell Gray Bruni			<b>Job No:</b>	EGB1704		
<b>Project:</b>	Modeina Estate - Stage 22 (Level 1)			<b>Report:</b>	2		
<b>Location:</b>	Burnside						

Sample No	4	5	6			
Date Tested	23/06/2021	23/06/2021	23/06/2021			
Time Tested	PM	PM	PM			

Test Location	Refer to Plan	Refer to Plan	Refer to Plan			
Level/Layer	2	2	1			
Layer Thickness	mm 200	mm 200	mm 200			
Test Depth	mm 175	mm 175	mm 175			
Field Wet Density	t/m <sup>3</sup> 1.90	t/m <sup>3</sup> 1.97	t/m <sup>3</sup> 1.98			
Field Moisture Content	% 27.9	% 27.3	% 26.9			
Material:	Site Derived Clay	Site Derived Clay	Site Derived Clay			

Oversize Material	WET, % 0.0	WET, % 0.0	WET, % 0.0			
Sieve Size	mm 19	mm 19	mm 19			
Peak Converted Wet Density	t/m <sup>3</sup> 1.97	t/m <sup>3</sup> 1.98	t/m <sup>3</sup> 2.04			
Optimum Moisture Content	% 29	% 28	% 27			



  

<b>Moisture Ratio</b>	% 96	% 97.5	% 99.5			
<b>Moisture Variation from OMC</b>	% -1.0 Drier	% -0.5 Drier	% 0.0 OMC			
<b>Density Ratio</b>	% 96.5	% 99.5	% 97.0			

<b>Specification:</b>	95% STD	<b>Test Selection:</b>	N/A
<b>Notes:</b>	Ref: 1120 0252-1 (SI02)		
<b>Test Method</b>	AS1289 5.8.1, 5.7.1, 2.1.1, 1.1	<b>Sampling Method:</b>	AS 1289 1.2.1 6.4(b)


  

 <p><b>NATA</b> WORLD RECOGNISED ACCREDITATION</p>	<p>NATA Accredited Laboratory No. 20172</p> <p>Accreditation for compliance with ISO/IEC 17025 - Testing</p> <p>The results of tests, calibrations and/or measurements included in this document, are traceable to Australian / National Standards</p>	<p>Approved Signatory:</p>  <p>David Burns</p> <p>Date: 29/06/2021</p>
---	--	---





Test Location

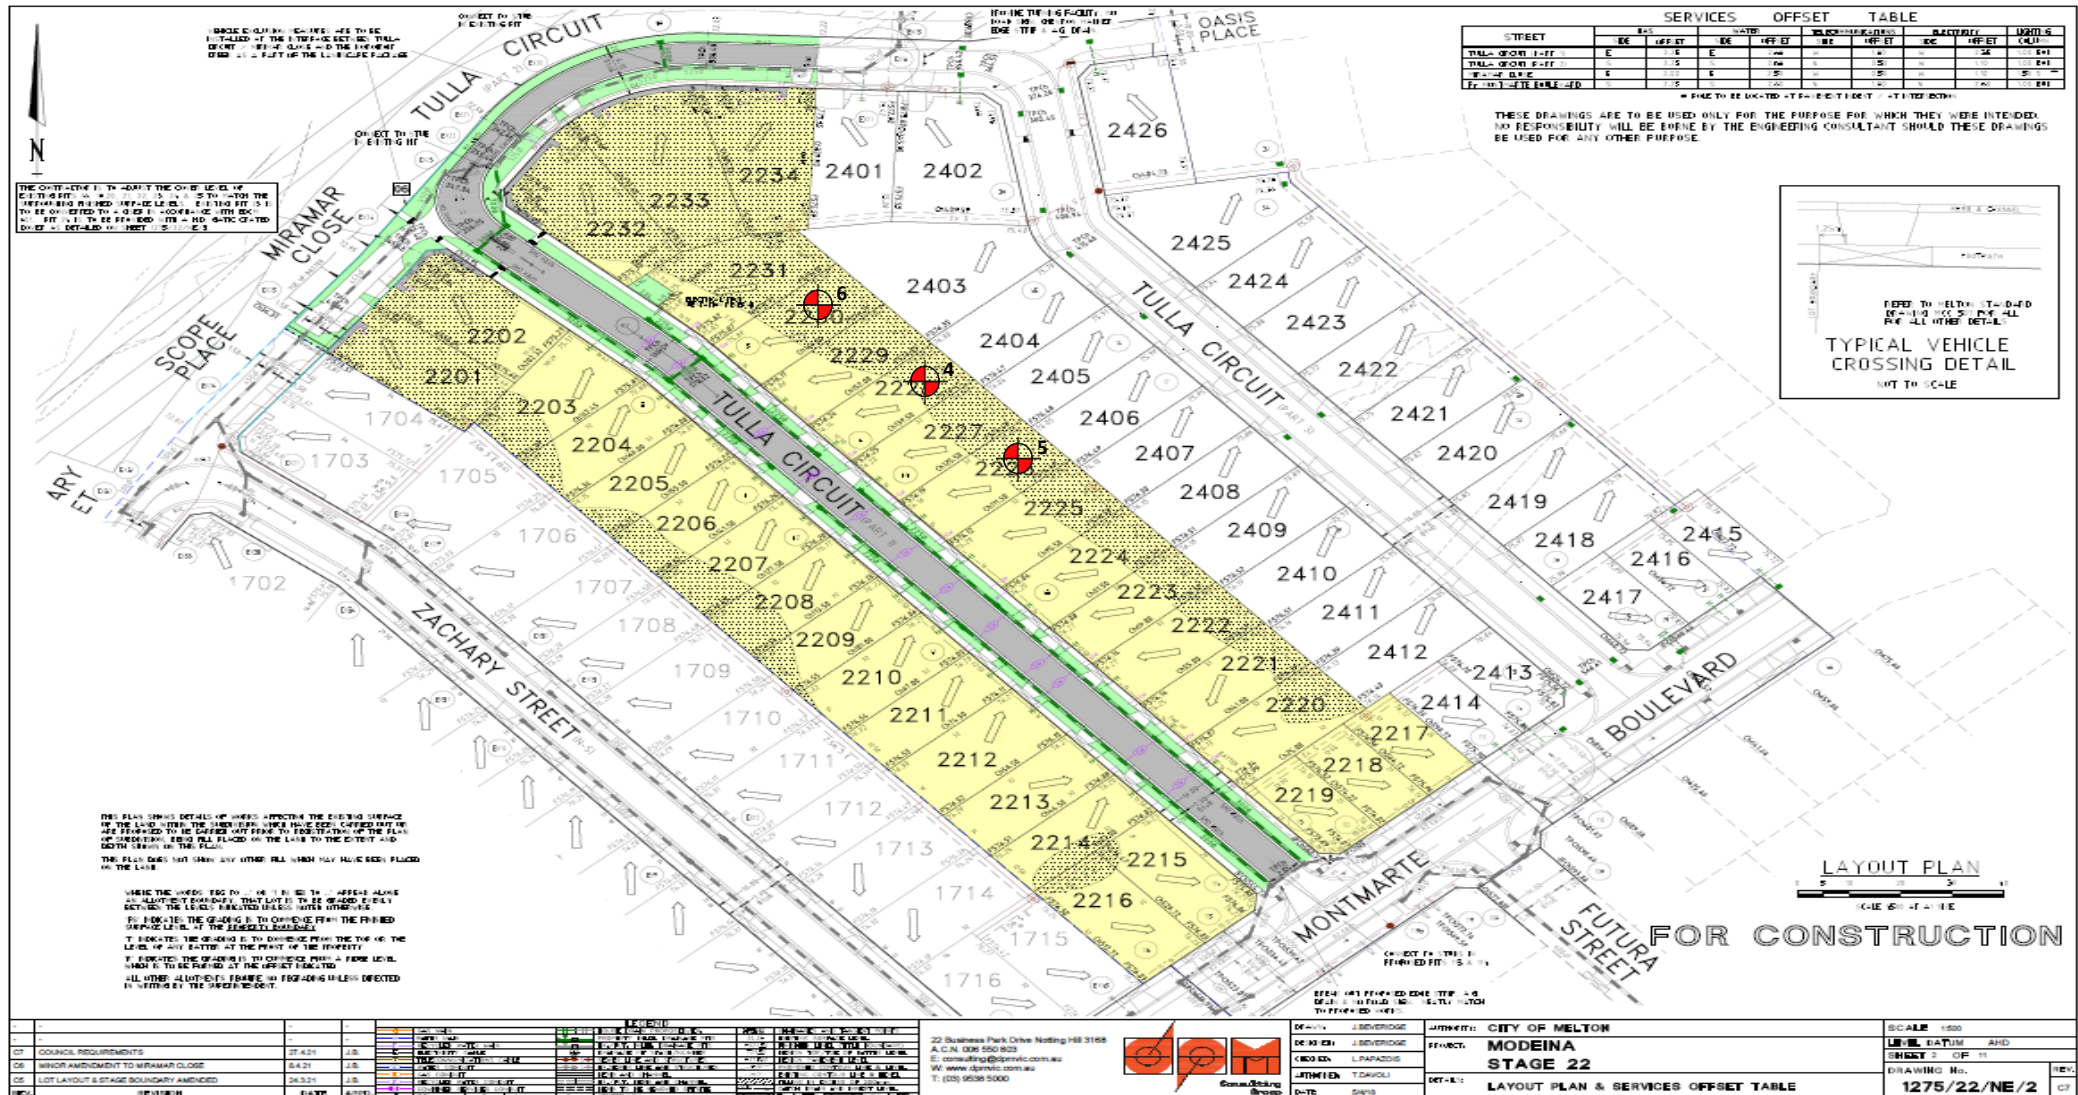

PROJECT:  
Modeina Estate – Stage 22 (Level 1)

CLIENT:  
Excell Gray Bruni

DATE:  
23/06/2021

LOCATION:  
Burnside

PROJECT No:  
1120 0252-1 (SI02)

SITE PLAN SKETCH—NOT TO SCALE



## Field Density Test Results AS1289.5.7.1

A & Y Associates Pty Ltd  
5/16 Network Drive  
Truganina VIC 3029  
PH: 0400 413 531  
info@ayassociates.com.au

<b>Client:</b>	Excell Gray Bruni			<b>Job No:</b>	EGB1704	
<b>Project:</b>	Modeina Estate - Stage 22 (Level 1)			<b>Report:</b>	3	
<b>Location:</b>	Burnside					
Sample No	7	8	9			
Date Tested	24/06/2021	24/06/2021	24/06/2021			
Time Tested	PM	PM	PM			
Test Location	Refer to Plan	Refer to Plan	Refer to Plan			
Level/Layer	1	1	FSL			
Layer Thickness	mm 150	150	150			
Test Depth	mm 125	125	125			
Field Wet Density	t/m <sup>3</sup> 1.91	1.88	1.86			
Field Moisture Content	% 25.1	25.8	25.6			
Material:	Site Derived Clay	Site Derived Clay	Site Derived Clay			
Oversize Material	WET, % 3.3	2.4	2.7			
Sieve Size	mm 19	19	19			
Peak Converted Wet Density	t/m <sup>3</sup> 1.97	1.97	1.94			
Optimum Moisture Content	% 28	28.5	28.5			
<b>Moisture Ratio</b>	% 89.5	90.5	90			
<b>Moisture Variation</b>	% -2.5	-2.5	-2.5			
<b>from OMC</b>	Drier	Drier	Drier			
<b>Density Ratio</b>	% 96.5	95.5	95.5			

<b>Specification:</b>	95% STD	<b>Test Selection:</b>	N/A
<b>Notes:</b>	Ref: 1120 0252-1 (SI03)		
<b>Test Method</b>	AS1289 5.8.1, 5.7.1, 2.1.1, 1.1	<b>Sampling Method:</b>	AS 1289 1.2.1 6.4(b)



NATA Accredited Laboratory No. 20172  
Accreditation for compliance with ISO/IEC 17025 - Testing  
The results of tests, calibrations and/or measurements included  
in this document, are traceable to Australian / National Standards

Approved Signatory:




David Burns

Date: 01/07/2021





Test Location

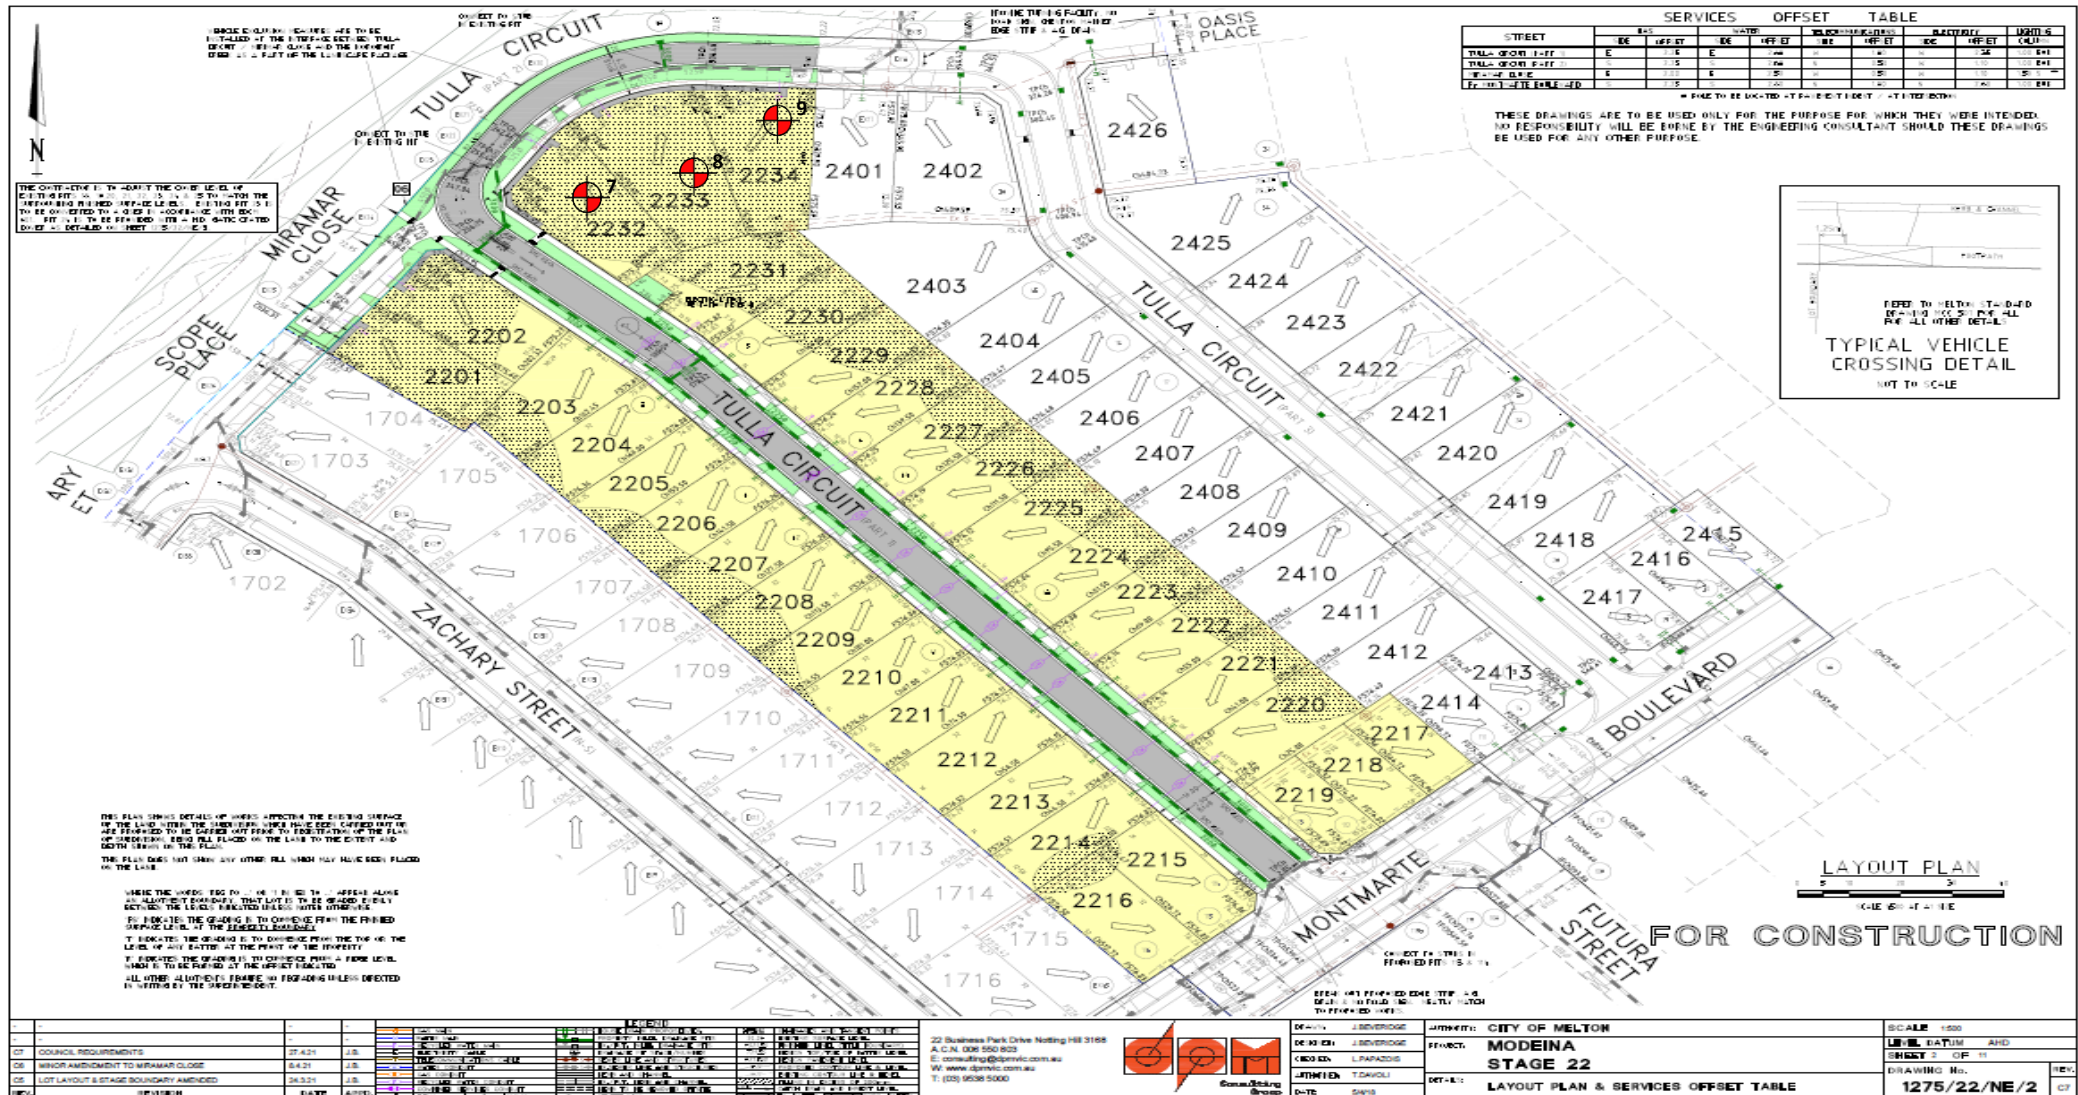

PROJECT:  
Modeina Estate – Stage 22 (Level 1)

CLIENT:  
Excell Gray Bruni

DATE:  
24/06/2021

LOCATION:  
Burnside

PROJECT No:  
1120 0252-1 (SI03)

SITE PLAN SKETCH—NOT TO SCALE

